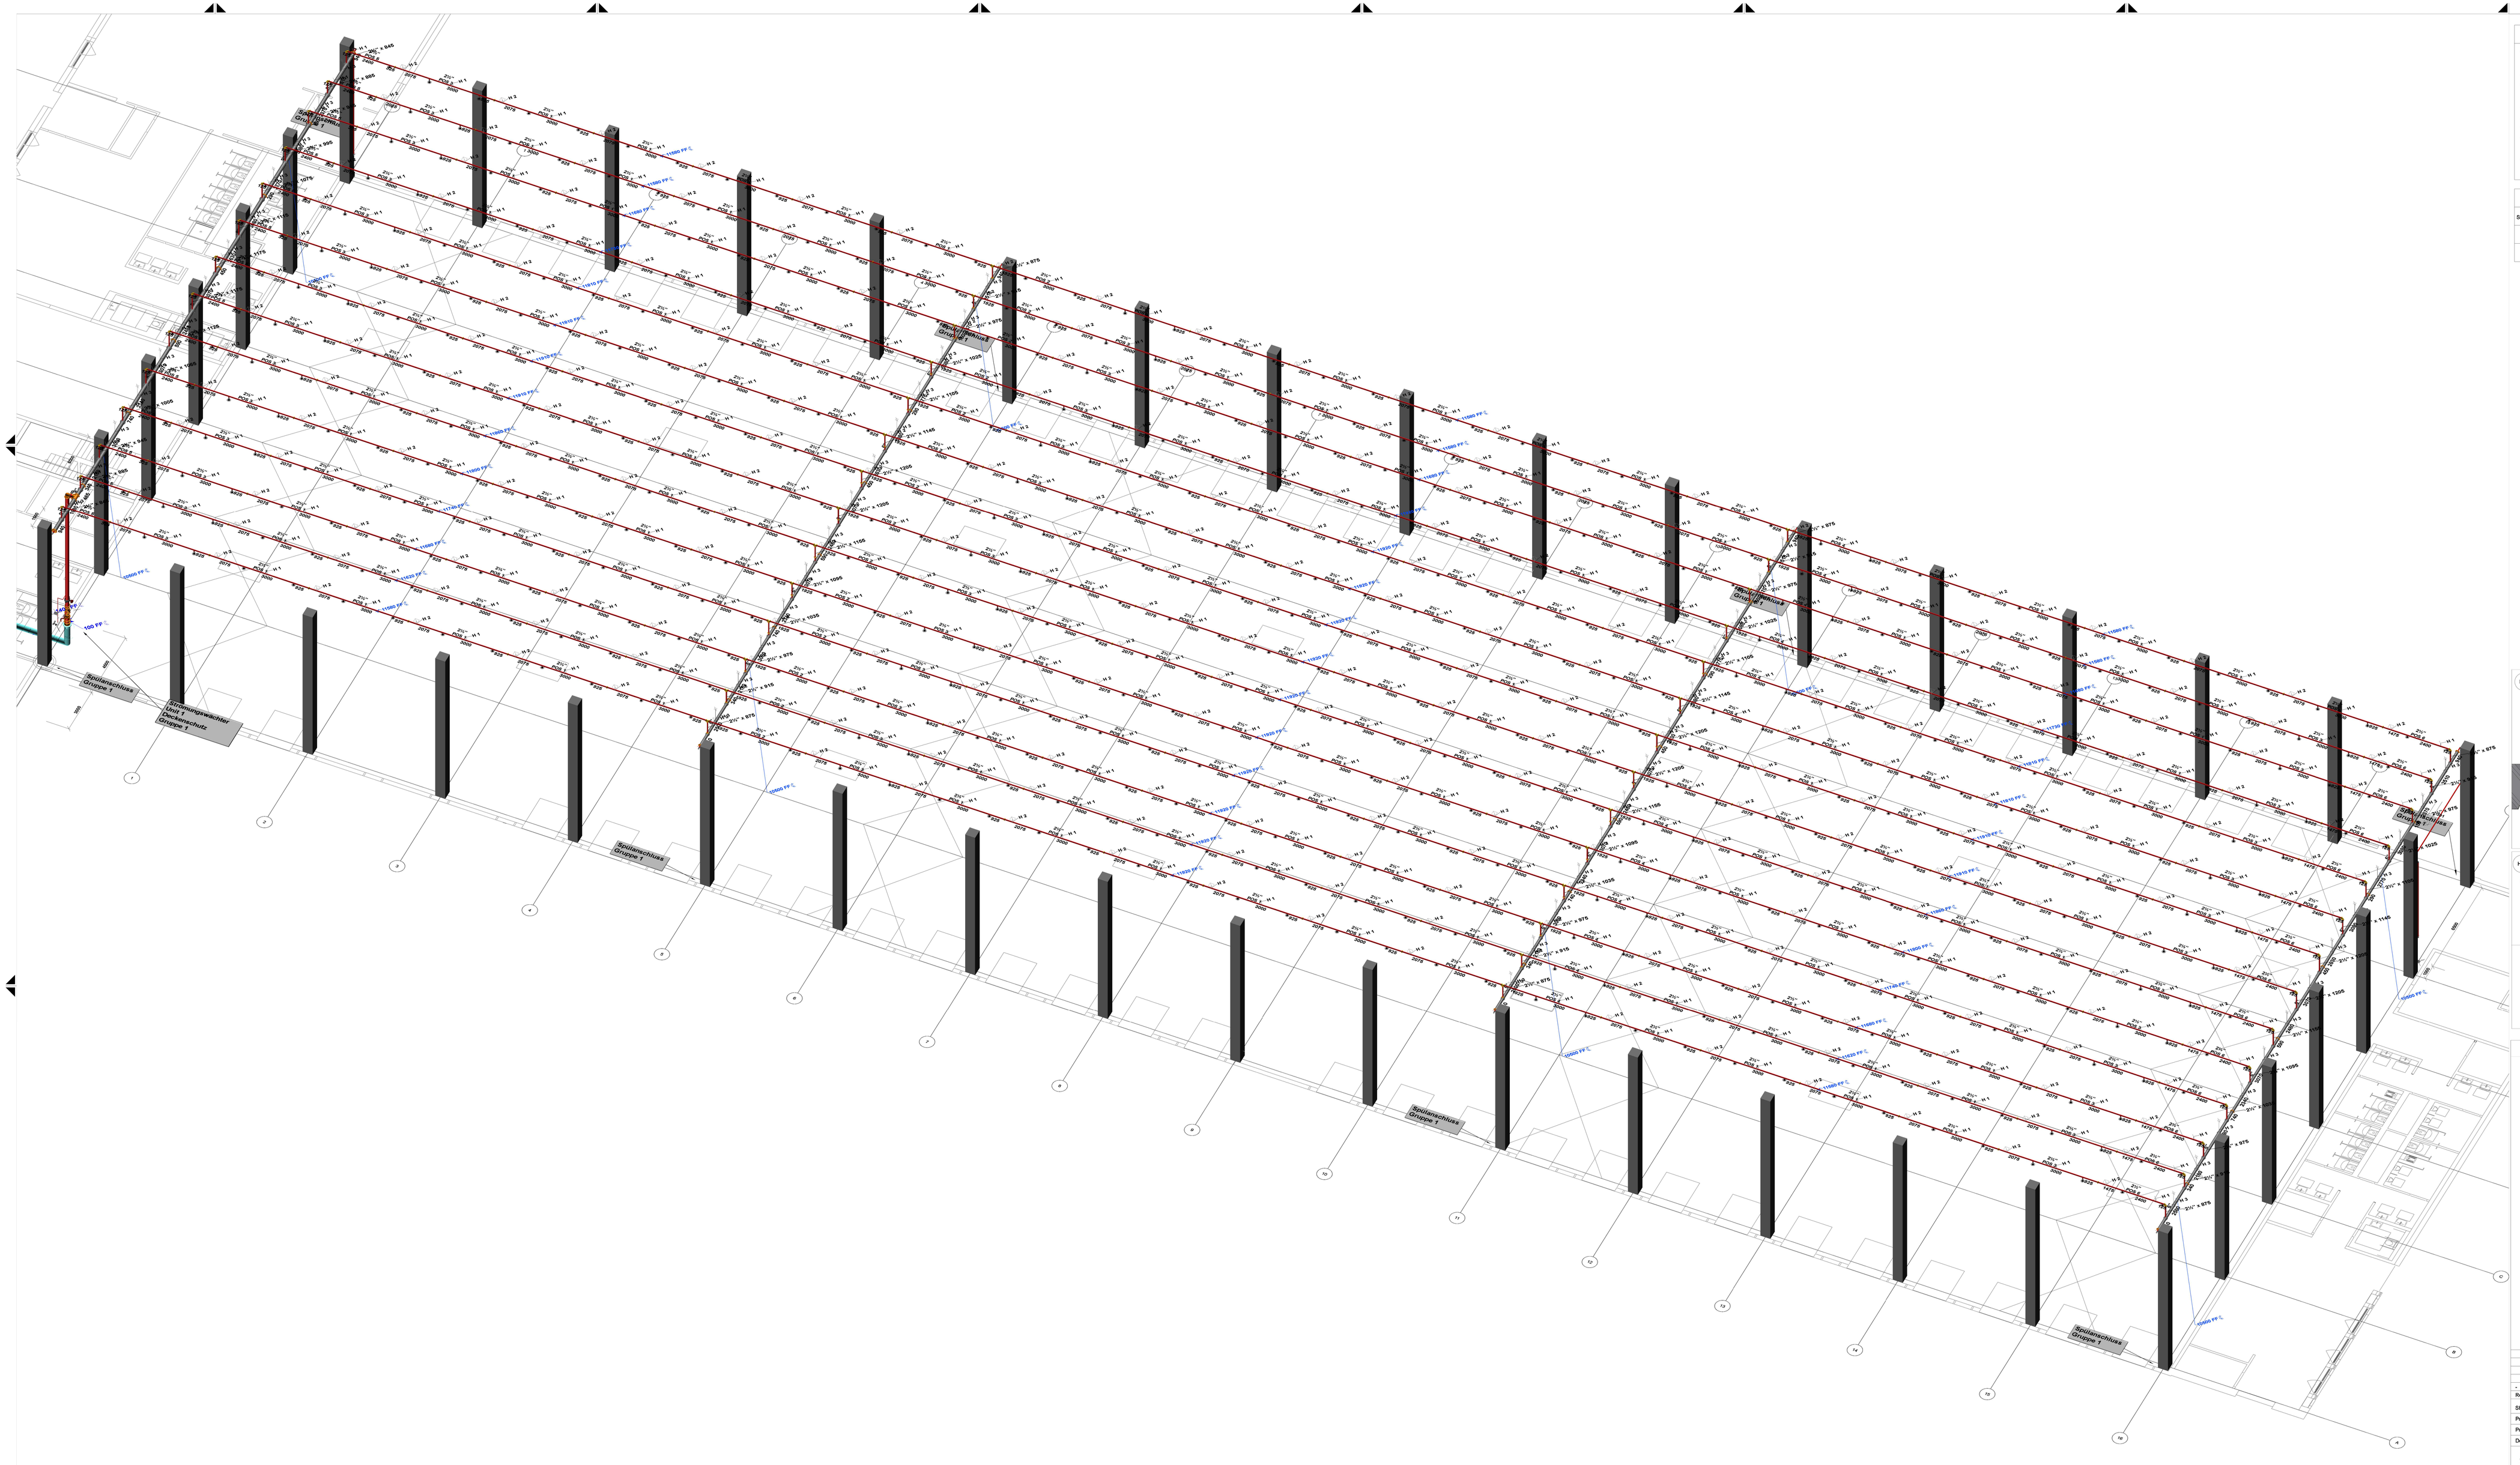

Deckenschutz Gruppe 1	
Gebäude/ Raumhöhe	Bis 12,2 m (innen gemessen)
Nutzung	Lagerung
Anlagenart	Nasseanlagen
Sprinklertyp	ESFR
K-Wert	360
Auslösetemperatur	74°C
Auslösezeitindizhiert	Schnell (RT < 80)
Wirkfläche	108 m² (12 Sprinkler)
Wasserbeaufschlagung	12 Stück K-360 @ 4,1 Bar
Max Schutzfläche / Sprinkler	9 m²
Wirkzeit	60 min
Richtlinien	FM 8-9

Sprinkler Legend

Symbol	Manufacturer	S/N	Quantity	K-Factor	Type	Response	Finish	Temperature
●	Tyco	TY9226	616	362.9	Pendent	Quick	Brass	74°C
		Total:	616					

Detail Sprühbehinderung hängende Lagersprinkler (ESFR)

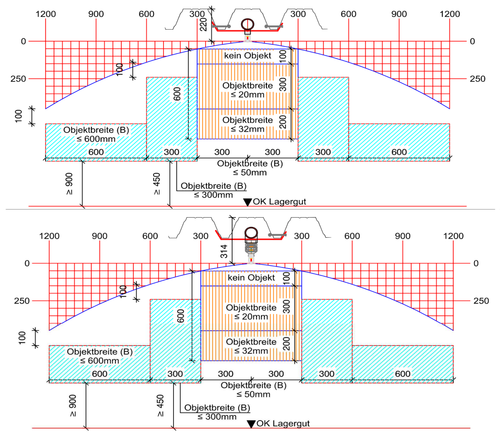

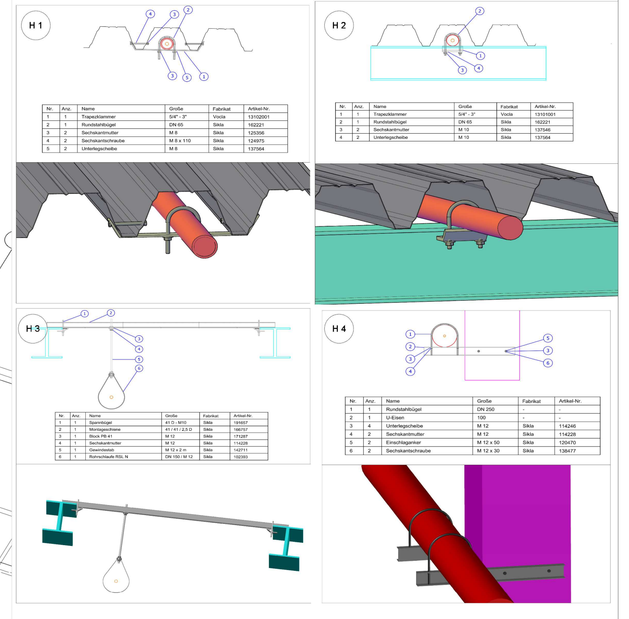

LAGEPLAN

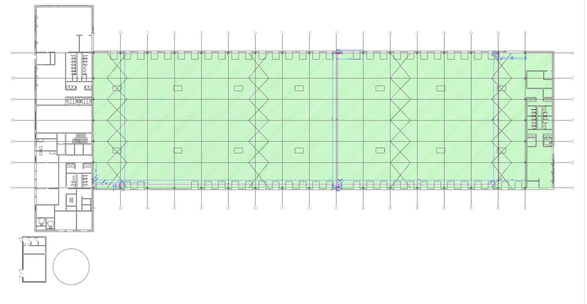

Revision n°:	Date revision:	Designer:	Remarks :	Checked by :

Sheet Name: -

Project name : -

Project n° : - | Drawing n°: FST | Checked by : -

Designer : - | Date : -

FST FIRE SAFETY TECHNOLOGY

FPS
Fire Safety Technology
Kiszinlec 2
67-200 Zaskowice
Poland
T: 0048 516 57 67 66

The copyright on this drawing is prohibited by law to FST and should not without written permission of FST be copied , digital duplicated nor shown to non-participants of the project.

Method A-ISO 128

Format drawing : 1600 x 900

Scale : 1:-